


6/7/10 cli

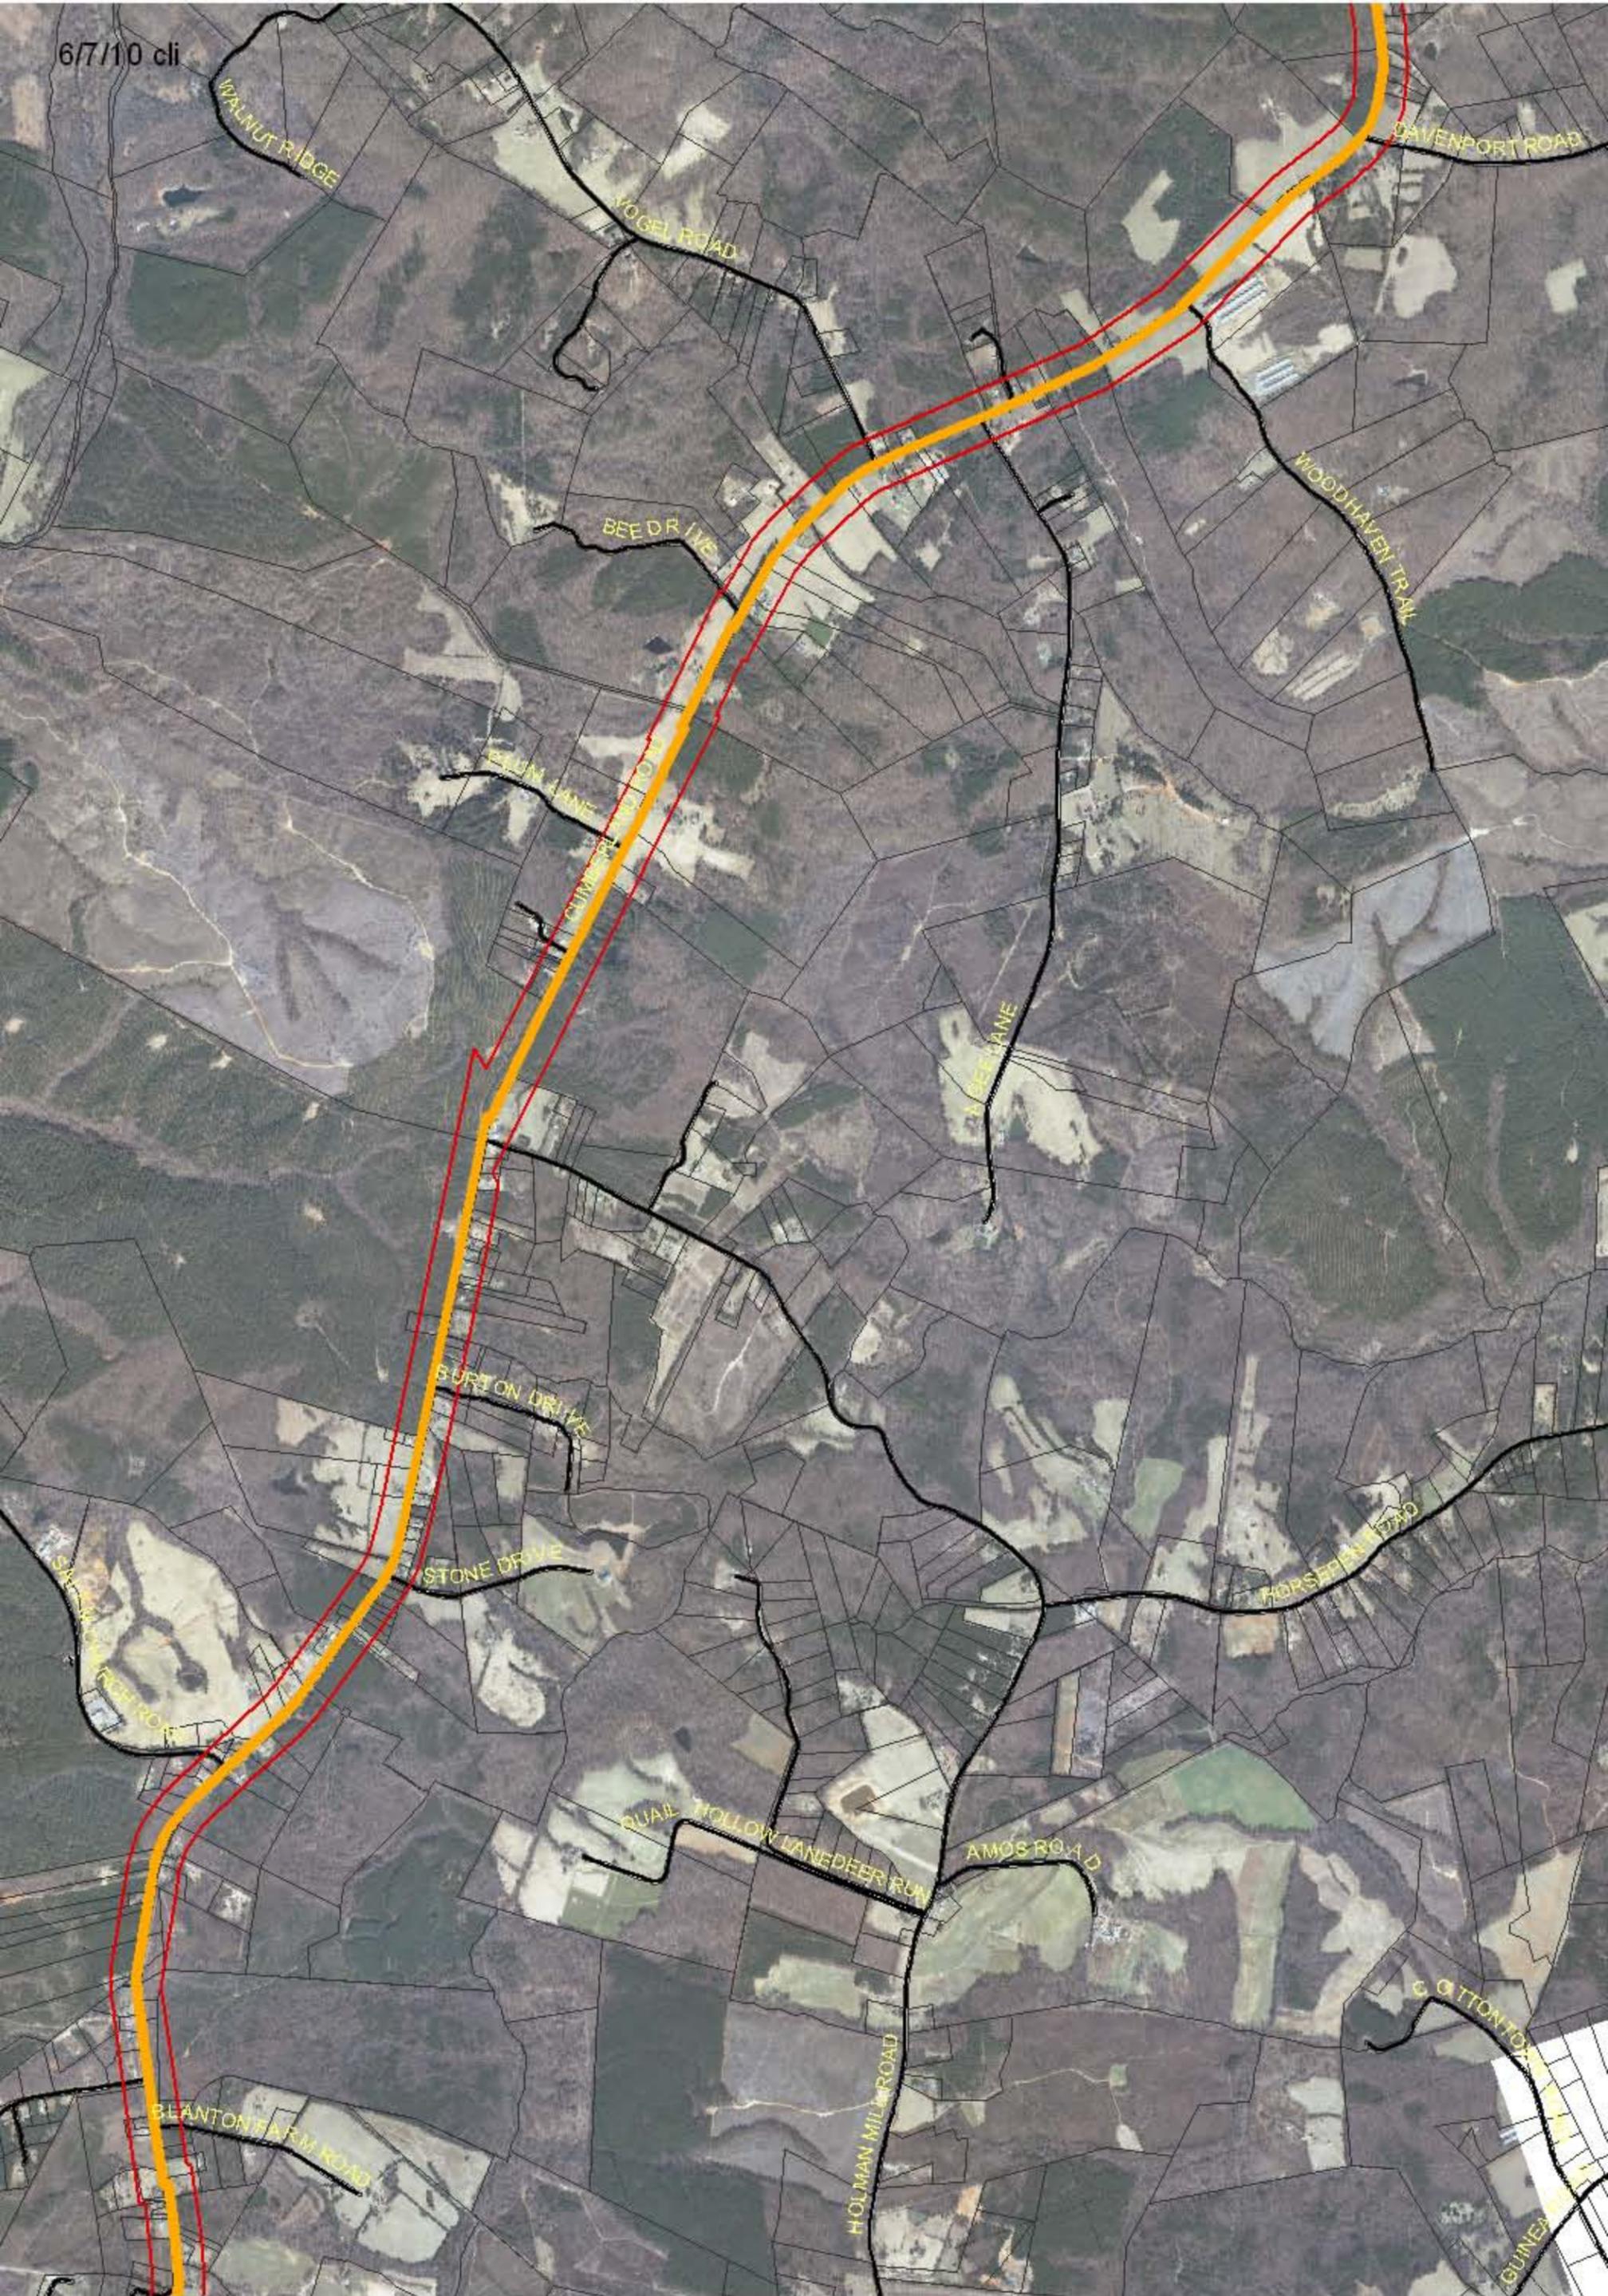

Rt. 45 South Utility Service Area - Sewer 1 of 2

Effective July 1, 2010

Legend

- █ Sewer-ForceMain
- █ Sewer-GravityFeed
- █ 300ft Connection Distance Requirement

0 600 1,200 2,400 Feet

